



Gallagher

Starter Kit Cabinet

Installation Note

Gallagher Starter Kit Cabinet: C300120



1 The Gallagher Starter Kit Cabinet

The Gallagher Starter Kit Cabinet is a secure metal enclosure for access control equipment. There are two PCB locations in the Cabinet; a half footprint and a full footprint. The Cabinet also provides installation space for a Gallagher Power Supply, 3.5A (C200340) and standby 12 V batteries.

A Gallagher Controller 6000 can be mounted directly into the half footprint location. Optical tamper protection via the Controller 6000 has been provided for both the front and rear of the Cabinet.

The following Gallagher PCBs must be mounted to a Gallagher Mounting Plate (C200001), when installed in the full footprint location:

- Gallagher Fuse & Fire Relay Board (C300993)
- Gallagher HBUS 8 In 4 Out Board (C300684)
- Gallagher HBUS 8 In Board (C300680)
- Gallagher HBUS 8 In 2 Out Door Module (C300660)


Note: GBUS is not supported from version vEL9.10 of Command Centre.

The standby batteries (not provided with the Cabinet) fit inside the Cabinet without physically interfering with the other components. Ensure that only 12 V batteries are used, and the batteries are wired in parallel.

Cabinet dimensions are: 500 mm (19.7 in) x 400 mm (15.7 in) x 150 mm (5.9 in).

1.1 Installation Example

The following photo and diagram is an example of how the Gallagher Starter Kit Cabinet can be used to accommodate a number of Gallagher PCBs.

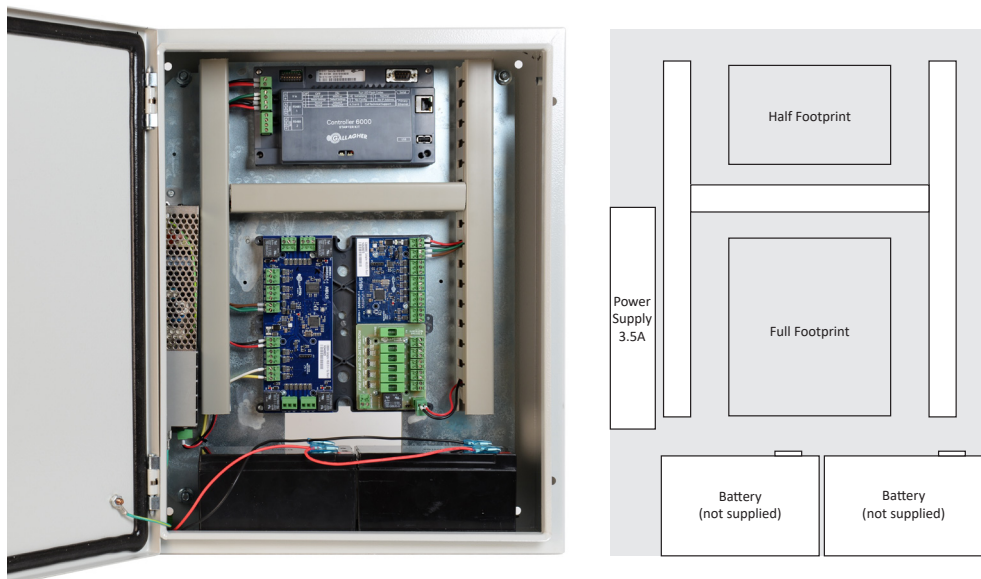

2 Before you begin

2.1 Shipment contents

Already fitted in the Cabinet:

- 1 x Door earth wire (part number 2K1161)
- 1 x Power Supply earth wire (part number 2K1163)
- 1 x Rear Tamper Light Pipe wrapped with reflective label and grommet (part numbers 4G0671, 3B1896 and 2M1467)
- 1 x Metal Mounting Plate with ducting (part number 4G0172)

Supplied in plastic bag taped to the outside of the Cabinet:

- 1 x Gallagher Starter Kit Cabinet Installation Note (part number 3E3723)
- 2 x Cabinet keys
- 8 x Screws (for the attachment of Gallagher mounting plates)

2.2 Cabling

The system or building cabling should be carried out prior to the installation of the Cabinet. The type of cable and the number of cables that enter the Cabinet will depend on the type of board(s) that are installed.

2.3 Tamper Detection

The half footprint location provides rear optical tamper detection through a light pipe in the back face of the Cabinet for the Gallagher Controller 6000. The rear tamper detector senses if anyone attempts to remove the Cabinet from its mounting position.

The reflective label attached to the inside surface of the Cabinet door is used by the Controller's front tamper detector. The front tamper detector senses when the Cabinet door is opened.

Notes:

- The Cabinet cannot have any third party hardware mounted inside that contains LEDs, as the LEDs may affect the operation of the front tamper.
- Tamper detection is supported for the Gallagher HBUS 16 In 16 Out Board by moving the horizontal ducting down and installing the board in the half footprint location.

2.4 Wiring

The Cabinet has an earth wire connected between the Cabinet and the door, and an available connection for a Power Supply (with a 6.4 mm earth tab). If this wire is disconnected during installation, please ensure that it is reconnected.

3 Installation

1. Unlock and open the Cabinet door.
2. Remove the Metal Mounting Plate from the Cabinet.
3. Cables can enter the Cabinet through the knockouts located on the sides of the Cabinet, or through the space provided in the rear of the Cabinet. It is preferable for optimal work height that the cable exit the wall and enter the Cabinet at eye height or just below, (i.e. approximately 1.6 m from the floor).
4. Mark the position of the four mounting holes, on the surface that you intend to secure the Cabinet to.
5. Mark on the surface, the tamper hole location for the Controller 6000.
6. Mount the reflective label on the wall and ensure it is firmly stuck in place. This white, adhesive reflective label (provided with the Cabinet) must align with the light pipe located in the back of the Cabinet.
7. Secure the Cabinet to the wall, using a minimum of four self tapping screws. The Cabinet must be tight against the wall. This ensures the distance between the reflective label and the optical tamper detector is kept to a minimum.
8. Using the four M3 screws provided with the Controller 6000, mount the Controller to the half footprint location on the Metal Mounting Plate.

Note: Rear tamper on the Controller 6000 is only supported if the Controller is installed in the half footprint location. If the Controller 6000 is installed in the full footprint location the rear tamper should be disabled.

9. If required, mount the Gallagher Mounting Plate (C200001) to the full footprint location on the Metal Mounting Plate.

Note: The Gallagher Mounting Plate (C200001) is **not** required when mounting the following PCBs to the full footprint location on the Metal Mounting Plate:

- Gallagher Controller 6000 with attached I/O Mounting Plate
 - Gallagher Controller 6000 with attached 8H/4H HBUS Module
 - Gallagher Controller 6000 with attached 8R/4R Reader Module
 - Gallagher HBUS 16 In 16 Out Board
10. Using the M3 screws provided with each Gallagher PCB, mount the optional Gallagher PCBs to the Gallagher Mounting Plate (C200001).
 11. Mount the Gallagher Power Supply to the Metal Mounting Plate.
 12. Mount the Metal Mounting Plate (with PCBs) into the Cabinet.
 13. Wire in the data and power connections. Ensure the cables are stored neatly within the ducting provided.
 14. Connect the earth wire from the Cabinet to the Power Supply.
 15. Install the standby 12 V battery(s) and connect to the Power Supply.
 16. Connect the mains power to the Power Supply.
 17. Ensure all equipment operates correctly both with mains power on/battery on and with mains power off/battery on.
 18. Label all connections using the component identification decal(s). Fix the component identification decal(s) to the inside of the Cabinet door. Do not fix the decal(s) over the reflective label required for the Controller's front tamper detector.
 19. Close and lock the Cabinet door.
 20. Initialise the optical tampers on the Controller 6000. Refer to the topic "*Optical Tamper Detectors*" in the Gallagher Controller 6000 Installation Note (3E2028).

4 Approvals and Compliance Standards

AS/NZS IEC 60839.11.1:2019 Grade 4, Class II

Disclaimer: This document gives certain information about products and/or services provided by Gallagher Group Limited or its related companies (referred to as "Gallagher Group"). The information is indicative only and is subject to change without notice meaning it may be out of date at any given time. Although every commercially reasonable effort has been taken to ensure the quality and accuracy of the information, Gallagher Group makes no representation as to its accuracy or completeness and it should not be relied on as such. To the extent permitted by law, all express or implied, or other representations or warranties in relation to the information are expressly excluded. Neither Gallagher Group nor any of its directors, employees or other representatives shall be responsible for any loss that you may incur, either directly or indirectly, arising from any use or decisions based on the information provided. Except where stated otherwise, the information is subject to copyright owned by Gallagher Group and you may not sell it without permission. Gallagher Group is the owner of all trademarks reproduced in this information. All trademarks which are not the property of Gallagher Group, are acknowledged.